




اية ون ايميرتس كليننج سير فيسز (ش.ذ.م.م.)  
A ONE EMIRATES CLEANING SERVICES LLC

## Water Tank Cleaning & Disinfection

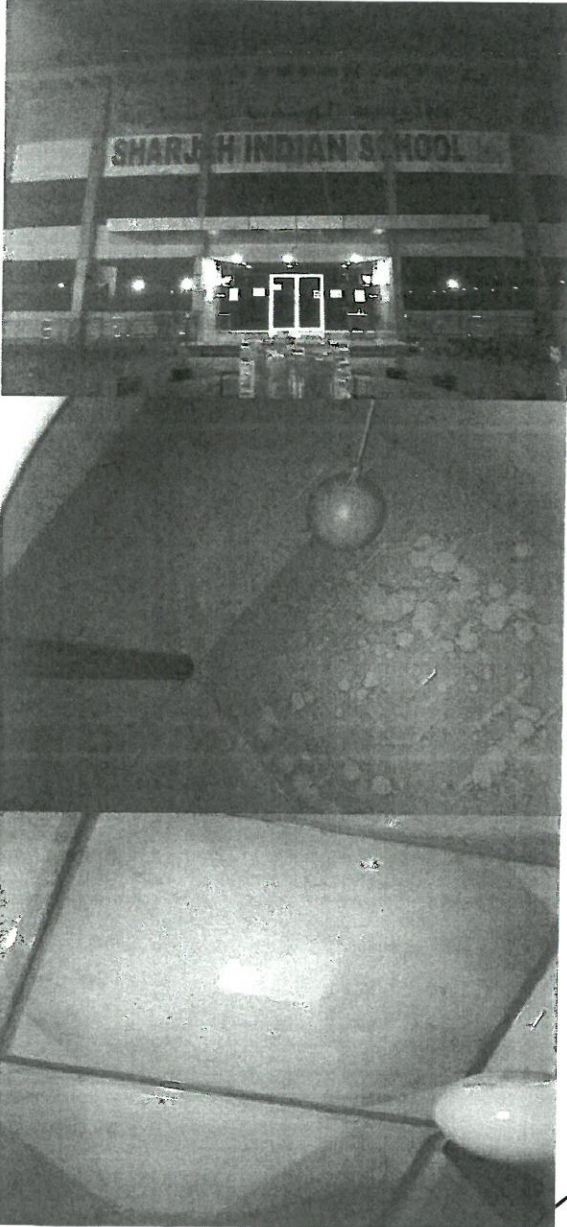


CLIENT: SHARJAH INDIAN SCHOOL

JOB LOCATION: JUWAIZA,  
SHARJAH, UAE

REPORT BY:  
SERVICES A ONE EMIRATES CLEANING LLC

REPORT COMPLETION DATE:

26 DECEMBER 2024



*Handwritten signature and date 04/12/2024*

MOB.: +971 56 722 5993, +971 54 433 7454, +971 54 767 4563, DUBAI-UAE  
EMAIL: aoneec@gmail.com, WEB: www.aoneemirates.com

**SPECIALIZED CLEANING SERVICES FOR**  
WATER TANKS, AC DUCTINGS & KITCHEN EXHAUST SYSTEM

Section	DESCRIPTION
1	Front Cover
2	Index
3	Summary of all work undertaken
4	Invoice(s) No.
5	ASR
6	Cleaning & Disinfection Certificate signed & stamped
7	Digital Photographs A4 glossy (before & after)

  
04.02.2025



Following the request of IAS to quote for the cleaning of Water Storage Tanks for SHARJAH INDIAN SCHOOL in JUWAIZA, SHARJAH.  
The quotation and schedule of works was submitted for cleaning works to be carried out last 24 DECEMBER 2024. A one emirates mobilized giving assignment to team A consisting of:

- 1 Team Leader + 2 Hygiene Technicians
- All necessary equipment required to carry out such work

## SUMMARY OF WORK UNDERTAKEN

### INSPECTION OF THE WATER STORAGE TANKS

Found out that the other internal lid of the basement supply tank was dropped inside the tank and had sludge and dirt. Also found out that there are no built-in access ladders inside. The two GRP tanks upstairs are in very good condition and well covered minimizing the growth of contaminants inside the tank

### OBSERVATION IN GENERAL


Inspection of Water Storage Tanks:

- Water Storage Tanks System was found in its good manner, tanks has integrity to supply clean and potable water.

## SUMMARY OF WORKS UNDERTAKEN

We have successfully cleaned and disinfected all of the following:

- Water Tank

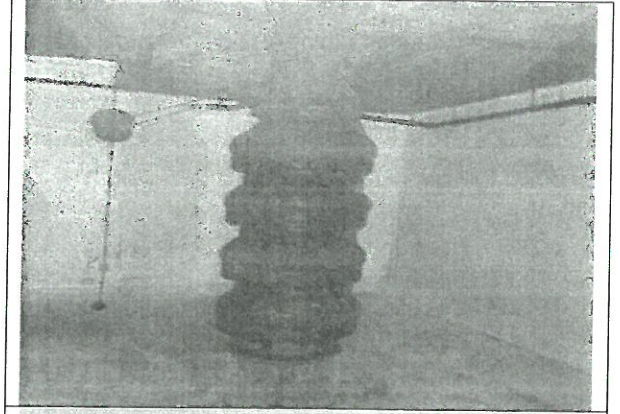

28/12

Amulya  
04-12-2023







# اية ون ايميرتس كليننج سير فيسز (ش.ذ.م.م.) A ONE EMIRATES CLEANING SERVICES LLC

CUSTOMER: SHARJAH INDIAN SCHOOL		ASR Job No. 2450DWT	
Contact Person: Mr. Kareem		Tel No.:	
Position:		Fax No.:	
Order Date: DECEMBER 2024		Mobile No.:	

Date Cleaning Started – 24 DECEMBER 2024		Last Cleaned – SEPTEMBER 2024						
Date Ended – 20 SEPTEMBER 2024		Hours Worked –		Team	A	B	C	D
Type of Building	<input checked="" type="checkbox"/> Commercial	<input type="checkbox"/> Residential		<input checked="" type="checkbox"/> Other				
Location of Water Tank	<input checked="" type="checkbox"/> Roof	<input checked="" type="checkbox"/> Ground		<input checked="" type="checkbox"/> Basement				
Designation of Water Tank	<input type="checkbox"/> Feeder Tank	<input checked="" type="checkbox"/> Dist Tank		<input checked="" type="checkbox"/> Other				
Maintenance work carried out	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Area cleared of all debris		<input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes		
<input type="checkbox"/> Concrete Uncoated	<input type="checkbox"/> Molded Fiber Glass	<input type="checkbox"/> GRP Panel		<input type="checkbox"/> Steel Panel				
<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> Galvanized	<input type="checkbox"/> Polyurethane		<input type="checkbox"/> Others				
Tank water Quantity	<input type="checkbox"/> Full	<input type="checkbox"/> Half Full		<input type="checkbox"/> ¼ Full				
Condition of Tank	<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty		<input type="checkbox"/> Very Dirty				
Bio-film/Staining	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Sediments		<input type="checkbox"/> Yes	<input type="checkbox"/> No		
Mould	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Algae		<input type="checkbox"/> Yes	<input type="checkbox"/> No		
Lid Fitted	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Damaged		<input type="checkbox"/> Yes	<input type="checkbox"/> No		
Leaks Present	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Location		<input type="checkbox"/> Tank	<input type="checkbox"/> Valve	<input type="checkbox"/> Pipe	
Vent Screen Present	<input type="checkbox"/> Yes	<input type="checkbox"/> No		<input type="checkbox"/> Not applicable				
Vent Screen Installed	<input type="checkbox"/> Yes	<input type="checkbox"/> No		<input type="checkbox"/> Not applicable				
Pumps Working	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Valves Working		<input type="checkbox"/> Yes	<input type="checkbox"/> No		
Pipes	<input type="checkbox"/> Galvanized	<input type="checkbox"/> PVC	<input type="checkbox"/> Copper	Tank Fitted with Drain		<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Ladder Inside	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Ladder Outside		<input type="checkbox"/> Yes	<input type="checkbox"/> No		
Pipes Disinfected	<input type="checkbox"/> Yes	<input type="checkbox"/> No		<input type="checkbox"/> Not Applicable				


## Fill this up when doing residential villas

Test Method			Result	Discharge Pipe	Dilution Quantity
<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3			
Legend			1 = Result	2 = Discharge Pipe	3 = Dilution Quantity

## Comments & Suggestions

Photo's Attached	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Additional Information Attached	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Label filled in and left on tank	<input type="checkbox"/> Yes	<input type="checkbox"/> No	Maintenance in attendance	<input type="checkbox"/> Yes	<input type="checkbox"/> No

Signed in behalf of A one Emirates LLC:

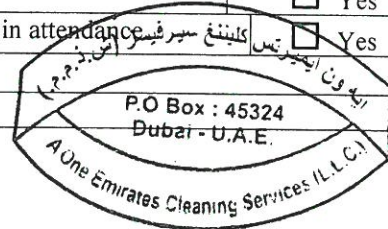

22

04.01.2025



## CLEANING CERTIFICATE

This to certify that SHARJAH INDIAN SCHOOL located in JUWAIZA, SHARJAH, UAE, whose WATER STOREGE TANKS has been Cleaned & Disinfected in accordance to Municipality Standards.

Date of Issue : 26 DECEMBER 2024  
Location of System : School Premises  
Date of Cleaning : 24 DECEMBER 2024  
Frequency of Cleaning : Every Six (6) Months  
Date next Inspection is due : 23 JUNE 2025

The procedures employed in this cleaning service complies with Dubai municipality Standards for approved cleaning companies, together with DM technical notes entering confined space. It also complies with A one Emirates Method Statement for pollutants, contaminants and safe chemical handling. All Chemicals used are certified by Dubai Municipality, Sharjah Electric & Water Authority, & Environmental Health Services Jebel Ali Free Zone Authority.

On behalf of: **A ONE EMIRATES CLEANING SERVICES LLC**  
Signed:




Handwritten signature in green ink.

Handwritten signature in green ink with date 04.02.2025 below it.






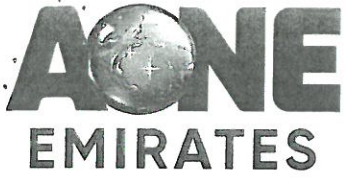

اية ون ايميرتس كليننج سير فيسز (ش.ذ.م.م.)  
A ONE EMIRATES CLEANING SERVICES LLC

## BEFORE DURING & AFTER PHOTOGRAPHS

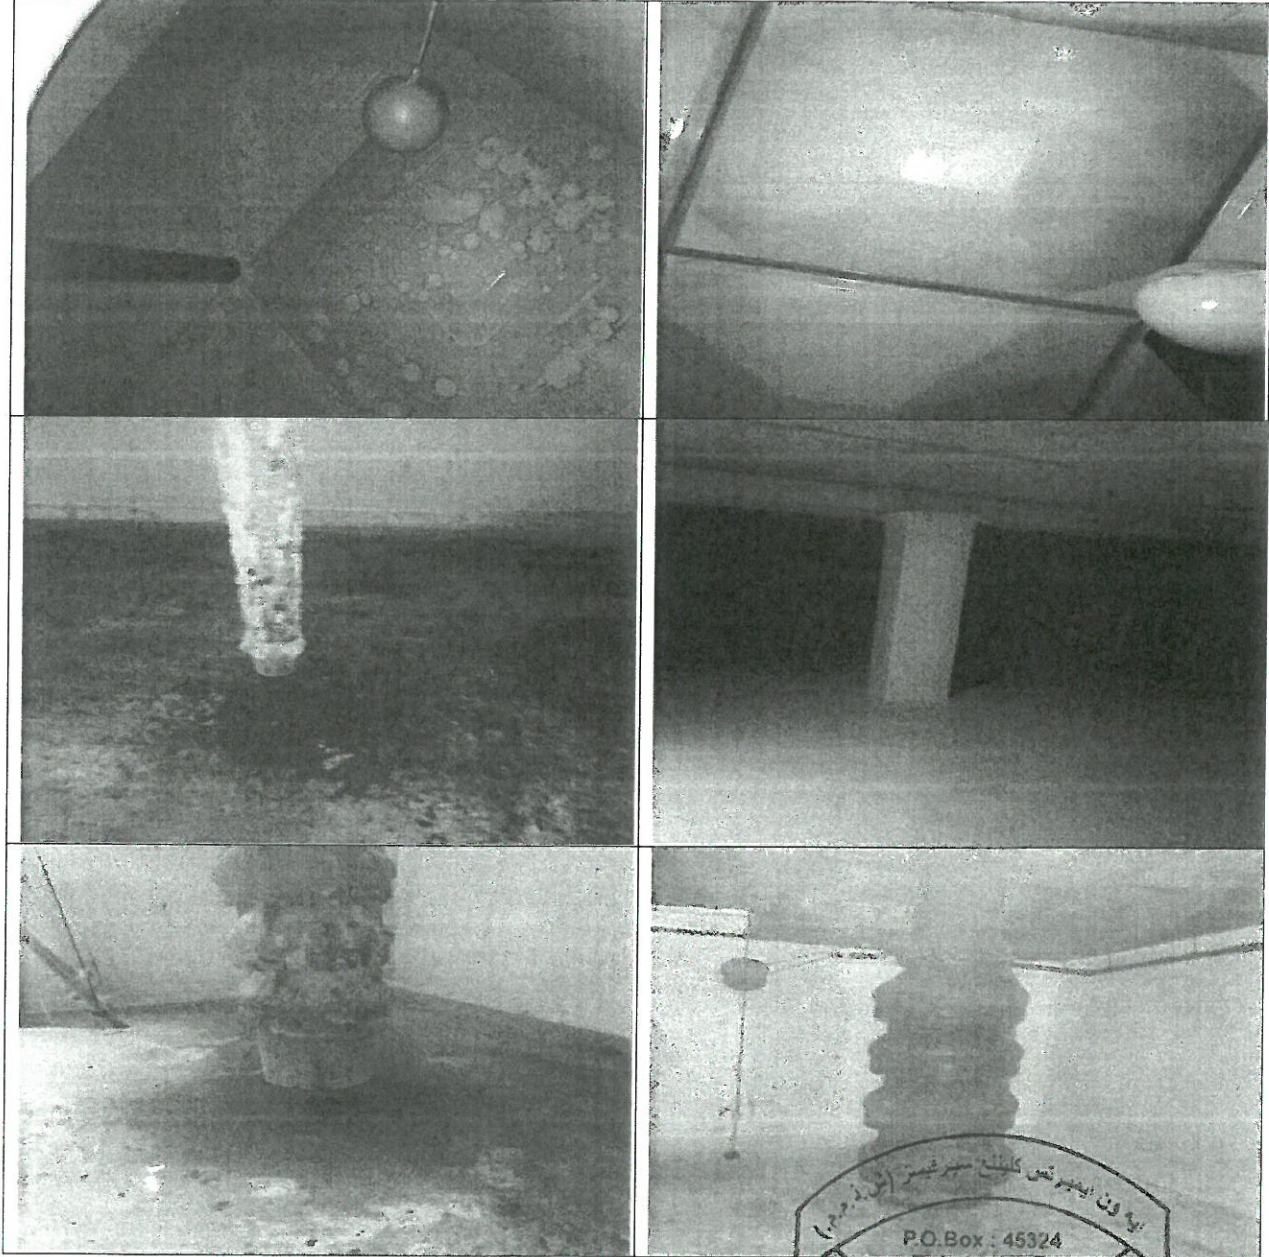

04

Amey  
04-02-2018



MOB.: +971 56 722 5993, +971 54 433 7454, +971 54 767 4563, DUBAI-UAE  
EMAIL: aoneec@gmail.com, WEB: www.aoneemirates.com



اية ون ايميرتس كليننج سير فيسز (ش.ذ.م.م.)  
A ONE EMIRATES CLEANING SERVICES LLC

### CERTIFICATE OF DISINFECTION

This certificate certifies that the water tank facilities has been professionally disinfected in compliance with Food safety department requirements for water tank cleaning in the United Arab Emirates. This certificate is valid for 6 months from the date of cleaning and disinfection of the water tanks at Sharjah Indian School, Juwaiza, Sharjah

Date of issue: 26 DECEMBER 2024

Date of cleaning: 24 DECEMBER 2024

Frequency of cleaning and disinfection: Every 6 months

Certified by

A ONE EMIRATES CLEANING SERVICES L.L.C



26/12

Amely  
04-12-2024





**JOB COMPLETION REPORT**

ASR JOB NO: A12450DWT

DATE: 26/12/2024

ADDRESS: SHARJAH INDIAN SCHOOL, JUWAIZA, SHARJAH

**Nature of work**

Total number of tanks: 23

Total number of sweet water tank:

SI. N	WATER TANK STORAGE CAPACITY	NO. OF TANKS
1	1,000, 000 USG	01
2	20, 000 USG	04
3	5000 USG	04
4	1000 USG	08

Total number of grey water tank:

SI. N	WATER TANK STORAGE CAPACITY	NO. OF TANKS
1	12,000 GALLON	02
2	23,000 GALLON	02
	BOREWELL TANKS	
3	4,500 GALLON	01
4	1,500 GALLON	01

Cleaning, sterilizing and removing all precipitated materials inside water tanks. Water tank facilities has been professionally cleaned and disinfected in compliance with Food safety department requirements for water tank cleaning in the United Arab Emirates.

  
Signature of client  
A One Emirates Cleaning Services L.L.C





الجمعية الهندية بالشارقة  
INDIAN  
ASSOCIATION  
SHARJAH

Ref: IAS/16/AGR/WATER TANKS/2024-25

03-08-2024

**AMC (ANNUAL MAINTENANCE CONTRACT) TO PERFORM WATER TANK  
CLEANING AT SHARJAH INDIAN SCHOOL, JUWAIZA**

INDIAN ASSOCIATION SHARJAH, the owners of Sharjah Indian School, registered under the law of UAE and operating at the Emirate of Sharjah, here-in-after called the "First Party" and M/s. A ONE EMIRATES CLEANING SERVICES LLC., P.B.NO. 45324, DUBAI, UAE, a company organized and registered under the laws of the UAE, here-in-after called the "Second Party" entered into an agreement on this day, 03<sup>rd</sup> day of August, 2024.

**SCOPE OF WORK:** Cleaning, sterilizing and removing all precipitated materials inside Water Tanks for a period of 12 months by the Second Party from 03<sup>rd</sup> August 2024 to 02<sup>nd</sup> day of August 2025.

**TOTAL NO. OF TANKS-23**

**TOTAL NUMBER OF SWEET WATER TANK**

Sl. N	WATER TANK STORAGE CAPACITY	NO. OF TANKS
1	1,000, 000 USG	01
2	20, 000 USG	04
3	5000 USG	04
4	1000 USG	08

**TOTAL NUMBER OF GREY WATER TANK**

Sl. N	WATER TANK STORAGE CAPACITY	NO. OF TANKS
1	12,000 GALLON	02
2	23,000 GALLON	02
	BOREWELL TANKS	
3	4,500 GALLON	01
4	1,500 GALLON	01

The above work has to be certified satisfactorily from the school authority, after completion of each cleaning.

**TERMS & CONDITIONS**

Non hazardous materials should be used for sterilization; it should not affect general public's health and should not have any side effects in humans. The Cleaning Company should manage safe disposal of / discharge of waste water after chemical cleaning and ensure the standards are met and has to send the water sample for pH Test in accordance with Municipality & Environmental discharge regulations of UAE.





# الجمعية الهندية بالشارقة INDIAN ASSOCIATION SHARJAH

Total amount agreed for the above work is AED.11,100/- (Dirhams Eleven thousand one hundred only) +5% VAT.

Payment in Two equal installments of AED. 5550/- +VAT- each against submission of invoice

Contract Period : 1 year from the date mentioned in the Contract

Service : Two times in a year.

Guarantee period : 6 months.



If there is any issues/ fine from the Municipality, The Second Party will bear damages and cost related to that.


AGREED AND SIGNED  
FOR INDIAN ASSOCIATION SHARJAH

  
NISSARTHALANGARA  
PRESIDENT


  
SREE PRAKASH PURAYATH  
GENERAL SECRETARY

  
SHAJI JOHN  
TREASURER

FOR A ONE EMIRATES CLEANING SERVICES LLC.


  
JABIR (055 9340801)  
MANAGER



  
Prepared By

  
Verified By



  
04.02.2013




تليفون : ٥٦١٠٨٤٥ (٩٧١ ٦) ، فاكس : ٥٦١٠٨٠٥ (٩٧١ ٦) ص.ب. : ٢٣٢٤ ، الشارقة - الإمارات العربية المتحدة

Tel. : (971 6) 5610845, Fax : (971 6) 5610805, P.O. Box 2324, SHARJAH - UNITED ARAB EMIRATES, E-mail : mail@iassharjah.com  
Website : www.iassharjah.com



28/2



UNITED ARAB EMIRATES  
MINISTRY OF HEALTH & PREVENTION

الإمارات العربية المتحدة  
وزارة الصحة ورفاهية المجتمع

Licensing & Accreditation Department

إدارة الترخيص و الاعتماد

License Number 7800

رقم الترخيص

Establishment Ref. # 29039

رقم مرجع المنشأة

Establishment Name Sharjah Indian School - 1

المدرسة الهندية بالشارقة 1

Owner Name Ahmed Mohamed Hamad Almidfa

اسم المالك احمد محمد المدفع

Establishment Type Private

نوع المؤسسة خاص

Emirates Sharjah

الإمارة الشارقة

Classification School Clinic

تصنيف المؤسسة عيادة مدرسية

Location Al Juwaiza - Al Juwaiza

الموقع Al Juwaiza - Al Juwaiza

Date From 08/06/2024

من تاريخ 2024/06/08

Date To 07/06/2025

إلى تاريخ 2025/06/07

Add On Services

أضف على الخدمات



الإمارات  
THE EMIRATES



28/2



04-02-2025



الإمارات العربية المتحدة - حكومة الشارقة  
بلدية مدينة الشارقة  
United Arab Emirates - Sharjah Government  
SHARJAH CITY MUNICIPALITY

إدارة الرقابة والسلامة الصحية  
Department of Health  
control and Safety

شهادة مصادقة عقد مكافحة حشرات  
Pest Control Authentication Certificate

رقم رخصة الشركة المتعاقدة	759909
اسم الشركة المتعاقدة	SIS - Br - L
عنوان الشركة المتعاقدة	المدرسة الهندية بالشارقة - فرع 1
رقم هاتف الشركة المتعاقدة	0503689941
	الشارقة - حوزع - خلف شارع الذيد - مدرسة ملك حكومة الشارقة

رقم رخصة شركة مكافحة	571461
اسم شركة مكافحة	الامين لتنظيف المباني ومكافحة الحشرات
عنوان شركة مكافحة	الشارقة - بوطينة - خلف شارع الشرق - محل رقم 3
رقم هاتف شركة مكافحة	0589547106

تاريخ بداية عقد مكافحة	03-08-2024	تاريخ نهاية عقد مكافحة	02-08-2025
------------------------	------------	------------------------	------------

قسم تنظيم ورقابة النفايات  
Waste Regulation and  
Control Department

هذه الوثيقة رسمية ولا تحتاج الى ختم أو توقيع  
This Document is Official ;it doesn't  
need be Stamped or Signed

9:27:13 AM  
Tuesday, September 17, 2024

تاريخ الإصدار	17-09-2024	تاريخ الانتهاء	02-08-2025
رقم الإيصال	106372227	تاريخ الإيصال	17-09-2024

04-02-2025

04-02-2025

